



Methodology for Reporting Commercial Office Plug Load Energy Use

Establishing common reporting metrics for the energy use of plug load equipment and aggregated office spaces to support energy modeling, benchmarking, and the evaluation of plug load measures

March 2013

Prepared by:

New Buildings Institute:

Dan Harris, Project Manager, dan@newbuildings.org,

Cathy Higgins, Research Director, higgins@newbuildings.org,

PECI:

Eliot Crowe, Senior Technical Manager, ecrowe@peci.org,

Joan Effinger, Engineering Manager, jeffinger@peci.org,

Lia Webster, Senior Engineer, lwebster@peci.org,

Supported by:

California Energy Commission
Public Interest Energy Research Program (PIER)

INTRODUCTION

Plug loads are becoming the biggest energy end use in commercial office buildings. This is in part because plug loads are growing in absolute terms with greater Information Technology (IT) power demand, and also because design approaches, codes and efficiency programs typically address other end uses, e.g. lighting and HVAC. This results in plug loads having an increasingly higher percentage of the whole building energy use. This is particularly the case in Net Zero or Very Low Energy Buildings where designers use aggressive design strategies to reduce non-plug load energy usage.

Traditionally, plug loads have been difficult to reach with efficiency programs, and for good reasons. In many cases office tenants do not pay electric bills directly and therefore have no direct incentive to reduce plug load usage. They also use plug loads for business reasons which vastly outweigh the financial impact of a few dollars saved through energy efficiency. Also, plug loads are small and distributed; while they add up to a lot of energy, they are difficult to influence easily.

There are three primary approaches to mitigating plug load usage. One approach improves device efficiency standards (for example, the EPA's Energy Star certification program or California's Appliance Efficiency Regulations) so that equipment purchased for any office uses less energy than 'typical' equipment. Another approach seeks to implement measures and controls that mitigate plug load energy use in a particular office, such as plug load control strip incentives or proposed language in the Title 24-2013 Building Energy Efficiency standards requiring the use of switchable plug load outlets. Lastly, some programs have focused on behavioral methodologies such as competitions and energy use dashboard feedback to encourage reductions of plug load use through the voluntary use of controls or behavioral changes.

As building designers, real estate personnel and utilities seek new ways to reduce plug loads there is a need for data and information to support their decisions. Research data addressing current plug load trends and plug load performance data is not comprehensive. The data and results are often presented through different metrics, the level of detail can be quite specific (i.e. minute-by-minute) or only annual, and the perspective of how individual plug loads contribute to the total office or whole-building usage is usually not included.

NBI has conducted research on the energy use characteristics of plug loads in office spaces and other commercial buildings to provide a greater level of information to those seeking methods and programs for reducing plug loads. In analyzing the data NBI used a standardized set of metrics. The intention is that by utilizing a consistent analysis method the body of data on plug load usage and the impact of measures might be greatly expanded. Further, sufficient data at the office aggregated level might be collected to use in a benchmarking approach to provide a target for offices to achieve as part of a LEED-type rating system.

As described in this guide, the outcome of NBI's research provides building designers, real estate personnel and utilities with two fundamental ways for expressing energy use characteristics for commercial plug loads: (1) Plug Load Equipment Power Density (EPD) and Schedule and (2) Plug Load Summary Metrics. Each of these is described in general below:

Using data from past projects, this guide includes preliminary ranges for high, median, and low calculations of the metrics and EPD and Schedule. Lastly, the guide includes a summary of references for metering and monitoring equipment and project management.

Plug Load EPD and Schedule

This representation describes plug load energy use in the format used by an energy model such as DOE2 or EnergyPlus. A nominal equipment power density in Watts per square foot (W/SF) is multiplied by a fraction of usage for each hour of a typical day type. The day types are weekday, Saturday and Sunday/Holiday. The EPD can be expressed in W/SF or simply in W for an individual piece of equipment. An example of the hourly profile for a weekday is shown in Figure 1. In this case the EPD was determined to be 0.95 W/SF, and the Y-axis of the graph shows the fraction of power density for a ‘typical’ weekday at each hour of the day on the x-axis.

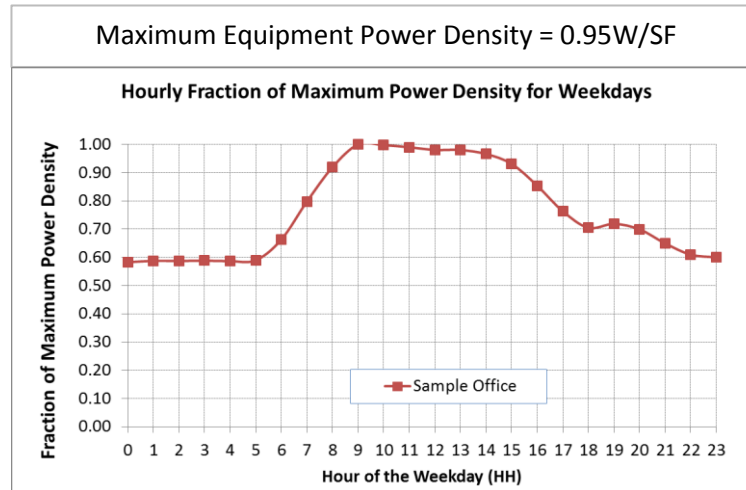


Figure 1 Example of an EPD and Schedule Representation

Plug Load Office Metrics

The EPD and Schedule in Figure 1 are difficult to use when comparing different office spaces or pieces of equipment. There is a need for a set of Key Performance Indicators (KPIs) that can summarize important aspects of the usage characteristics of an office space. These KPIs compare certain metrics of performance that inform opportunities for savings. Table 1 shows example metrics. The metrics are explained in detail in this guide.

Table 1 Example of plug load metrics for an office space

Metric	Unit	Value
Occupied Power Density	W/SF	0.61
Peak Power Density	W/SF	0.72
Weekday Power Density	W/SF	0.52
Overnight Ratio	-	70%
Weekend Power Density	W/SF	0.40
Weekend Ratio	-	77%
Annualized Energy Usage Density	kWh/SF	4.19

Intended Audience

This guide is primarily intended to be used by practitioners conducting research into electrical energy usage by plug loads or assessing savings due to plug load measures for office and miscellaneous equipment. The guide lays out the calculations for ensuring the results from a particular project can be merged with those in the greater body of plug load research; an approach that may be useful to a variety of audiences. These include:

Plug Load Efficiency Researchers: The guide is intended to drive the use of standardized metrics when measured studies of plug load usage or measure impacts are undertaken. Efficiency consulting companies, engineering firms and utility pilot program managers are examples of practitioners that may have research projects that resulted in measured data of plug load equipment or office spaces.

Rating System Administrators: Rating systems such as USGBC LEED for Commercial Interiors can use the metrics to establish a measured performance approach to high performance commercial office Tenant Improvement.

Dashboard or EMIS Vendors: Dashboard vendors or metering companies that work with measured data of office plug load usage.

Plug Load Measure Vendors: Companies that design and sell equipment that can be used to track, reduce or impact plug loads.

Energy Modelers: Critical to energy modeling is the accurate assumption of internal gains including the plug load magnitude and its schedule. These assumptions can greatly influence the design of other systems leading to oversized HVAC equipment and inefficient zoning.

Codes and Policy Authors: The developers of new codes, standards and policies addressing plug loads need data in order to define realistic specifications and allow for measurement against those specifications

Utility Analysts: Utility analysts need data that can be used to project the contribution of plug loads as part of a resource planning process.

Office Tenants or Facility Managers: Occupants need simple messages to identify plug load strategies to reduce usage. Facility managers are in a position to use existing or temporary metering to provide feedback to office tenants. The Plug Load Metrics are simple and informative.

TWO PLUG LOAD REPORTING METHODS

This section provides details on the calculation of the EPD and Schedule and Plug Load Metrics for office equipment and office spaces.

NBI recommends using an analysis period, i.e. the data range used to calculate metrics of performance, of at least 56 days (8 complete weeks) at intervals of 15-minutes. 'Before and after' analysis periods can be chosen in regular 56-day increments to assess the impact of measures or behavioral programs; a trailing 56-day period can be used regularly to track general office usage patterns. Longer periods of data will provide more statistically significant results.

Analysis periods should avoid weeks that contain major holidays (such as Christmas, Thanksgiving, July 4th, Memorial Day and Labor Day) as well as periods where occupancy was known to be deviated from what could be considered 'normal'.

Individual Plug Load Equipment versus Office Aggregated Plug Load Usage

NBI recommends that meter data from individual equipment be treated differently from meter data for office aggregated usage. The issue is whether to normalize the results by square footage of the office space or to leave the results as a metric of power.

Individual Equipment Meter Data

Individual pieces of equipment should be studied using the EPD and Schedule and Plug Load Metrics approaches using hourly power only, i.e. without normalizing for the square footage of the office space. The relatively low power of the device and the high office square footage divisor will result in very small numbers that will not translate well to aggregation or comparison.

Using the power without normalization will make aggregation of individual equipment easier. The data can be used to mock up any office space and to compare more directly with other, better designed, individual devices without the square footage confusion.

Aggregated Office Space Plug Load Meter data

Aggregated office spaces should use hourly power normalized by square footage for both reporting methods. The aggregated use of all equipment in the office space is unique to that office and normalizing by square footage establishes a useful metric that can be compared and applied as an example to other office spaces or modeled buildings.

Aggregated Whole Building Plug Load Meter Data

This guide does not cover situations where the whole-building aggregated plug load usage is metered. Whole-building plug load data should be calculated with the EPD and Schedule method with the whole-building square footage to normalize the results.

Plug Load EPD and Schedule

The purpose of the Plug Load EPD and Schedule (EPD&S) representation is to report plug load findings in a format that is used by building energy models. The availability of this data will improve the ability of modelers to make accurate assessments of equipment power expectations in office spaces and office buildings.

The input is a 56-day or longer, hourly-interval, energy use data series of an individual plug load piece of equipment. Data series of other intervals should be rolled up into hourly points.

As an example, the time stamp 12/1/2013 9:00AM contains the average power between 9:00 and 10:00.

1. Convert data at other intervals into an hourly power series with an hourly date/time stamp
2. Separate the data into three hourly series:
 - a. Non-holiday Weekdays
 - b. Saturdays
 - c. Sundays and Holidays
3. For each series, calculate the average power at each hour of the day across the entire monitoring period. For example, the average power at 9:00AM on each of the weekdays in the weekday series. The result is three data series of 24-points with time stamps from 0:00 to 23:00.
4. Find the single maximum power from all three 24-point series.
5. The fraction at each hourly time stamp for all three series is found by dividing the power at that point by the maximum power. Each fraction shall be rounded to two decimal places.

As an example, Table 2 shows a portion of an average hourly power series for a weekday for a desktop computer:

Table 2 An example of a portion of weekday average hourly data

Hour of Day	Average Hourly Power (W)	Max Power	Fraction
9:00	40	95	0.42
10:00	50		0.53
11:00	80		0.84
12:00	95		1.00
13:00	90		0.95
14:00	80		0.84
15:00	70		0.74

Maximum Power		83	
Desktop Computer			
Hour	Weekday	Saturday	Sun/Hol
0	0.35	0.35	0.34
1	0.35	0.36	0.34
2	0.35	0.36	0.35
3	0.35	0.36	0.35
4	0.35	0.36	0.35
5	0.36	0.36	0.35
6	0.40	0.36	0.35
7	0.52	0.36	0.35
8	0.88	0.36	0.35
9	0.96	0.37	0.35
10	1.00	0.37	0.36
11	1.00	0.36	0.35
12	0.90	0.36	0.35
13	0.92	0.35	0.35
14	0.93	0.35	0.35
15	0.91	0.35	0.35
16	0.83	0.35	0.35
17	0.61	0.35	0.35
18	0.49	0.35	0.35
19	0.43	0.35	0.35
20	0.40	0.35	0.35
21	0.39	0.35	0.35
22	0.38	0.35	0.35
23	0.36	0.35	0.35

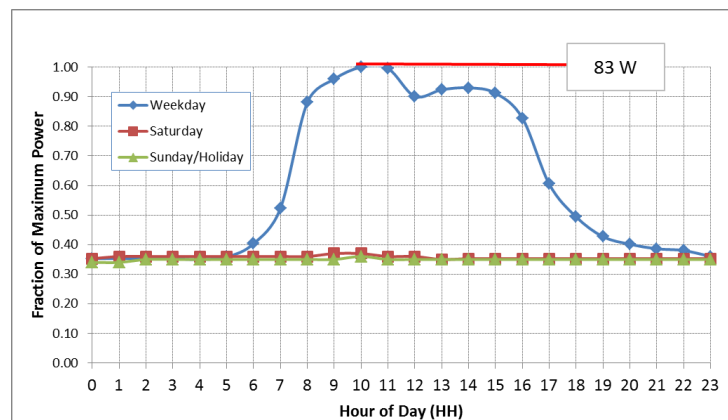


Figure 2 Example EPD and Schedule data for a hypothetical desktop computer

An example final result in graphical and tabular form for a desktop computer is shown in Figure 2. The table on the left shows the fraction data for each day type and the maximum power of 83 Watts. The illustration at right displays the data graphically showing the clear use of the computer on the weekdays and the base load of the weekends and holidays.

Office space aggregated plug load energy usage uses the same procedure to establish the three-day-type series used in the previous procedure but, as discussed above, uses a normalization of the office space square footage to improve the usefulness of the results. This is accomplished by adding a step to the procedure above:

6. Divide the maximum power by the office square footage.

The fractions will remain the same as without the normalization. Figure 3 shows the results taken from a 14,000 SF office space monitoring project over 6 months. Note the high base load fraction, approximately 60% of the maximum power density.

Nominal Power				9440
Nominal Power Density				0.67
Hour	Average Weekday	Average Saturday	Average Sunday-Holiday	
0	0.59	0.60	0.60	
1	0.60	0.60	0.60	
2	0.60	0.60	0.60	
3	0.60	0.59	0.60	
4	0.60	0.60	0.60	
5	0.60	0.60	0.60	
6	0.67	0.60	0.59	
7	0.80	0.58	0.59	
8	0.92	0.59	0.59	
9	1.00	0.60	0.59	
10	0.99	0.60	0.59	
11	0.99	0.60	0.59	
12	0.98	0.60	0.59	
13	0.97	0.60	0.59	
14	0.96	0.60	0.59	
15	0.93	0.60	0.59	
16	0.87	0.60	0.59	
17	0.78	0.59	0.59	
18	0.71	0.58	0.58	
19	0.71	0.58	0.59	
20	0.71	0.58	0.58	
21	0.68	0.59	0.58	
22	0.65	0.59	0.58	

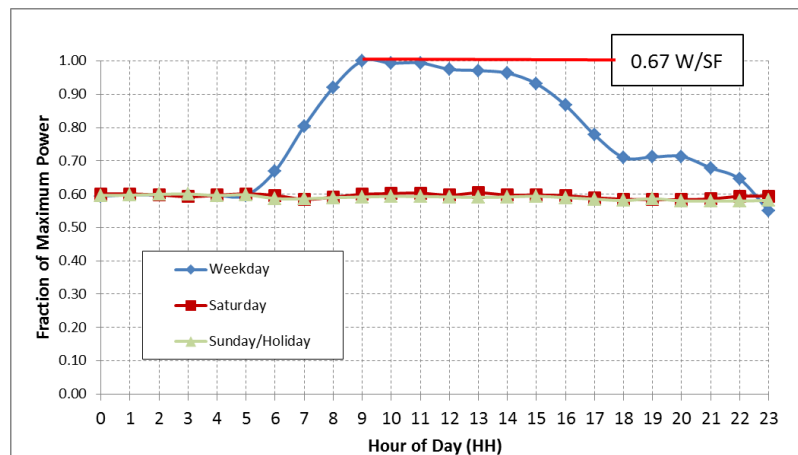


Figure 3 An example of EPD and Schedule results from a 14,000 SF office space

Plug Load Metrics for Office Spaces

The EPD and Schedule approach to plug load data analysis is very useful for building energy modelers but difficult to use when comparing two office spaces. However, using the Plug Load Metrics (“metrics”) makes the data more expressive for occupant feedback, benchmarking and gaining a quick understanding of how much and when plug load usage occurs in an office.

The metrics consist of average power values normalized by square footage, expressed in W/SF for fixed periods of time during weekdays (excluding holidays) and weekend-holidays (consisting of Saturdays,

Sundays and holidays)¹. The metrics also include two ratios intended to highlight nighttime usage and weekend usage. The square footage of the office is calculated using the guidelines found in Section Normalizing Office Characteristics. The metrics and descriptions are shown in Table 3.

Table 3 Plug Load Metrics for Office Spaces

Metric	Description	Unit
Occupied Power Density	The average power density between 6:00AM and 6:00PM on non-holiday weekdays	W/SF
Peak Power Density	The highest 15-minute power density observed in the monitoring period	W/SF
Weekday Power Density	The average 24-hour power density on non-holiday weekdays	W/SF
Overnight Ratio	The ratio of the average power density in the nighttime on non-holiday weekdays (i.e. 6:00PM to 6:00AM) and the daytime (i.e. the Occupied Power Density).	%
Weekend Power Density	The average 24-hour power density for non-workdays including all Saturdays, Sundays, and Holidays.	W/SF
Weekend Ratio	The ratio of the Weekend Power Density (numerator) and the Weekday Power Density (denominator). Expressed as a percentage.	%
Annualized Energy Density	The projected annual energy usage per square foot for the office space using the annual projection methodology.	W/SF

Occupied Power Density

This metric averages across the busiest part of the day and indicates average demand per SF on a typical workday between 6:00 and 18:00 in the measurement period. A particular office may have a different schedule of occupancy which will impact the metric, but the consistent definition of ‘Occupied’ makes it easier to compare across offices. The office characteristics include an estimate of weekly occupancy hours to make a more accurate comparison between two offices.

Peak Power Density

This metric provides a sense of the installed capacity of the plug load equipment in the office and the potential for permanent demand reduction for measures. The Peak Power Density is the highest 15-minute power demand density measurement in the monitoring period.

Weekday Power Density

This metric tells researchers what a normal workday is like and is used to calculate the annual energy usage for the office. The weekday power density is the average power density across all non-holiday weekdays in the monitoring period.

Overnight Ratio

This metric assesses how much equipment is left on at night. When office personnel undertake measures to switch things off at night, the efficacy of their actions can be established through a change in the Overnight Ratio. One of NBI’s notable findings in plug load research is that very few offices have

¹ The metrics currently use the combination of Saturdays, Sundays, and Holidays unlike the EPD & Schedule method which separates Weekdays, Saturdays, and Sunday/Holidays. The intent was to keep the number of metrics small. NBI may expand this in the future to separate Saturdays from Sunday/Holidays and create better alignment between the two methods.

an overnight ratio less than 50%. This demonstrates that there is significant opportunity to reduce plug loads at night.

Weekend Power Density

This metric assesses the average power density on non-workdays when the office is unoccupied. The metric serves to project annual energy consumption and compare to the Weekday Power Density. There may be offices that are open more days per week and NBI recommends using the office characteristics to improve comparisons. It is possible that Saturdays can be calculated separately from Sunday/Holiday days to better reflect conditions and align with the EPD and Schedule categorization but this is not included in this revision.

Weekend Ratio

This metric is a ratio of the average weekend power density over the average weekday power density. Similar to the Overnight Ratio, the Weekend Ratio tries to give a sense of how much equipment is running on days with low occupancy.

Annualized Energy Density

Annualized Energy Density is a projection of the annual kWh per year that the office space will use based on the shorter monitoring period used to calculate the metrics. The metric provides a simple analysis of before and after savings for measures or behavioral programs implemented in an office.

Table 4 shows the metrics for the same 14,000 SF office space example from Figure 3. The metrics allow easier interpretation of the usage patterns and characteristics of the office space. For example, the Overnight and Weekend Ratio are both at 70% or higher. This means that ‘at night’ the office uses 70% of the energy the office uses ‘in the daytime’. Clearly there is opportunity to save energy at night.

The Occupied Power density is 0.61 W/SF, which based on data NBI has collected is high but not particularly high. The modest number means savings opportunities in the daytime may be limited.

Table 4 An example of the Plug Load Metrics from a 14,000 SF office over 6 months of monitoring

Metric	Unit	Value
Occupied Power Density	W/SF	0.61
Peak Power Density	W/SF	0.72
Weekday Power Density	W/SF	0.52
Overnight Ratio	-	70%
Weekend Power Density	W/SF	0.40
Weekend Ratio	-	77%
Annualized Energy Usage Density	kWh/SF	4.19

Once the occupants enable measures or undergo a behavioral program the metrics are examined again to assess impacts. In particular, the Annualized Energy Usage Density provides a means to easily understand the energy savings per annum. Of course this is a projection of annual savings and must be treated as such.

NORMALIZING OFFICE CHARACTERISTICS

Normalizing results by characteristics of the office space helps to make more accurate ‘apples-to-apples’ comparisons for the purpose of benchmarking. Plug loads may vary in number and type depending on the size, density and use of the office space so it’s important to use characteristics to increase the usefulness of the results.

For example, if there are two offices of equal square footage but one has twice the number of employees is it useful to compare them without taking into account the differences? Some aspects will still be useful like the EPD and schedule data since this goes into a larger data set that drives the expectations of the modelers, and the Overnight Ratio or the Weekend Ratio which provide feedback about what loads are left on, but direct comparison of the W/SF numbers may not be useful.

This guide recommends certain normalizing characteristics.

Normalizing Characteristics

Office Square Footage – ANSI/BOMA Standard Z65.1-2010

The published standard ANSI/BOMA Standard Z65.1 provides detailed guidelines for the calculation of office square footage and serves as a serviceable guide for calculating the square footage for energy comparisons. The choice of square footage should acknowledge that the intended audience is the office tenant and should not include any energy usage of the core and shell spaces that are the responsibility of the owner or manager.

Hours of Occupancy

An assessment of the hours of weekly occupancy is useful to assess how much the office is used. This is an estimate of the number of days per week that the office is open and the average hours per day. For example, Office X is occupied 5 days per week (M-F) for 8 hours each day. This is a rough estimate that may vary depending on the week but helps to narrow the range of comparison office spaces.

This is not a perfect way of normalizing for hours of occupancy as the result is an estimate. In the future the plug load data itself will use an algorithm that separates base load hours from active hours to determine the hours of occupancy.

Occupant Density

This is accomplished by making a one-time assessment of the equivalent FTE of workers typically in the office space on a regular basis. For example, Office X that is 14,000 SF has 70 FTE that work out of the office. Ideally the occupancy is relatively stable and the monitoring period does not include weeks with major holidays (e.g. Christmas, July 4th or Thanksgiving) where significant deviations from normal occupancy can occur.

Employees working remotely are not considered in the FTE. This is a potential problem with benchmarking office spaces, but again it’s important that the range of comparisons be reduced, not made exact.

Server Closets and Data Centers

The presence of a large data center or server closet results in significantly higher overall energy usage and base load energy usage at the office level. The server closet may or may not have dedicated cooling that is separate from the building HVAC system. The presence of a server closets or data center should be noted. Also, the dedicated HVAC must be excluded from a measurement of the office aggregated usage. For example, does Office X have a server closet: Yes or No.

A BRIEF TAXONOMY OF OFFICE AND MISCELLANEOUS PLUG LOAD EQUIPMENT

As noted earlier, one of the biggest challenges in understanding and reducing plug loads is that they tend to be highly diverse and distributed; even a modestly-sized office can include over 1,000 plug loads (see the PECl Office Case Study in the Appendix as an example).

Given their quantity and diversity, it is important to have a method for classifying and grouping plug loads. A good taxonomy will enable meaningful analysis of the plug loads and also support efforts to hone in on areas for improvement. Overall, a plug load taxonomy helps in two primary ways:

Understanding building energy use: A plug load inventory is helpful for interpreting plug load metrics. For example, if an office has a relatively high Overnight Ratio, the inventory can be used to highlight essential 24-7 loads such as data servers and refrigerators. All other loads may be considered within scope for a project to reduce the Overnight Ratio, helping to hone in on the equipment with greatest potential.

Evaluating energy savings strategies: Once a tenant, owner or property manager decides to address plug loads they will be presented with many potential options, such as upgrading to higher efficiency equipment, installing plug load controls and behavior-based approaches. A plug load inventory can help in determining the relative magnitude of costs and savings from each of the options, e.g. Occupancy sensors might impact 19 conference/meeting rooms, while smart power strips might cover 178 cubicles.

Table 5 below provides a recommended structure for grouping plug load equipment for offices. Once one defines equipment categories, further separation into sub-categories will help to illustrate the bigger picture and hone in on areas of energy saving opportunity. The PECl case study gives an example of this.

Table 5 Recommended highest-level plug load equipment groups

Highest-Level Equipment Grouping	
1	Personal workstations/cubicles (open offices) and private office equipment
2	Conference/meeting room equipment
3	Shared office equipment
4	Kitchen and hospitality equipment
5	IT equipment
6	Miscellaneous equipment

Following the standard grouping approach in Table 5 will allow for easier comparison with peers as industry-wide statistical data grows. While this is recommended as the primary approach, some situations may warrant a different approach or additional grouping schemes (such as splitting plug loads by floor, department or other criteria).

While it is possible to develop energy use totals for each category and sub-category of the plug load equipment (through actual measurements or equipment specifications), this is unlikely to occur other than for in-depth research projects.

The first step in establishing a plug load inventory is to define distinct equipment types which are sub-categories of the highest-level groups in Table 5. We recommend three general rules of thumb:

- **Grouped equipment will generally have a similar use and similar load.** Under this rationale, while laptops and desktops have a similar use they have a different load and would be better separated into two equipment types.
- **Try to limit the total load encapsulated by equipment that falls into a “miscellaneous” or “other” equipment type.** Categories with a high total load are obvious choices for energy efficiency projects; it is hard to determine an appropriate strategy to address “miscellaneous” equipment.
- **Keep the number of equipment type categories to a minimum.** There will always be a trade-off between the desired granularity of data vs. the ease of analyzing and addressing issues. The optimal number of categories needs to be determined on a case-by-case basis, depending on the goals and resources for the project. For a typical modern office, expect perhaps 20-30 main plug load categories.

The PEI Case Study demonstrates a method of high level grouping and sub-categorization.

RANGES OF PERFORMANCE

The two methods described above enable ‘before and after’ comparisons of results that provide valuable information and feedback. Benchmarking the metrics, by comparing one office’s metrics against another, also serves as a valuable method for tracking progress but requires sufficient comparison data.

In the course of research on several projects NBI has collected data from offices that provide a modest start to a comparison set of data. This data set is taken from 17 office spaces with a monitoring period of at least three months per office. There are no normalizing characteristics other than office square footage.

Based on data collected to date, the ranges of metrics are shown in Table 6 for the benefit of designers and other parties. Comparison metrics are organized as: Low Case, Middle Case and High Case, with values for each metric.

Table 6 Ranges of metrics for NBI office space data set

Metric	Unit	Reference Data Ranges		
		High	Middle	Low
Occupied Power Density	W/SF	1.50	0.60	0.20
Peak Power Density	W/SF	2.00	0.80	0.40
Weekday Power Density	W/SF	1.40	0.45	0.15
Overnight Ratio	%	80%	50%	45%
Weekend Power Density	W/SF	1.40	0.30	0.08
Weekend Ratio	%	80%	60%	50%
Annualized Energy Density	kWh/yr.	10.00	3.25	1.00

Though the benchmarking of EPD’s and Schedules is not recommended as an ongoing practice, it is beneficial for modelers to understand how the spaces performed as metered data. Table 7 shows ranges of performance data taken from NBI’s analysis work on office spaces.

Table 7 Ranges of performance for EPD and Schedule data for office spaces

EPD	High Case			Middle Case			Low Case		
	Wkday	Sat	Sun/Hol	Wkday	Sat	Sun/Hol	Wkday	Sat	Sun/Hol
	1.63			1.00			0.76		
Hour	Wkday	Sat	Sun/Hol	Wkday	Sat	Sun/Hol	Wkday	Sat	Sun/Hol
0:00	0.98	0.98	0.98	0.36	0.32	0.32	0.43	0.39	0.38
1:00	0.98	0.98	0.98	0.36	0.32	0.31	0.44	0.40	0.39
2:00	0.97	0.97	0.97	0.35	0.32	0.32	0.44	0.39	0.39
3:00	0.98	0.98	0.98	0.35	0.32	0.32	0.43	0.39	0.39
4:00	0.97	0.97	0.97	0.35	0.32	0.32	0.43	0.39	0.38
5:00	0.97	0.97	0.97	0.36	0.32	0.32	0.42	0.38	0.38
6:00	0.97	0.97	0.97	0.40	0.32	0.32	0.44	0.38	0.38
7:00	0.97	0.97	0.97	0.52	0.32	0.32	0.49	0.38	0.38
8:00	0.98	0.98	0.98	0.88	0.32	0.32	0.72	0.38	0.38
9:00	0.99	0.99	0.99	0.96	0.33	0.32	0.87	0.39	0.39
10:00	0.99	0.99	0.99	1.00	0.34	0.33	0.90	0.39	0.39

11:00	1.00	1.00	1.00	1.00	0.33	0.33	0.93	0.40	0.39
12:00	1.00	1.00	1.00	0.90	0.34	0.34	1.00	0.40	0.40
13:00	1.00	1.00	1.00	0.92	0.34	0.34	0.95	0.40	0.39
14:00	1.00	1.00	1.00	0.93	0.35	0.35	0.91	0.40	0.39
15:00	0.99	0.99	0.99	0.91	0.33	0.35	0.87	0.39	0.39
16:00	0.99	0.99	0.99	0.83	0.33	0.34	0.79	0.39	0.39
17:00	0.99	0.99	0.99	0.61	0.33	0.34	0.62	0.38	0.39
18:00	0.99	0.99	0.99	0.49	0.33	0.33	0.51	0.38	0.38
19:00	0.99	0.99	0.99	0.43	0.32	0.32	0.51	0.38	0.39
20:00	0.98	0.98	0.98	0.40	0.32	0.33	0.59	0.38	0.39
21:00	0.99	0.99	0.99	0.39	0.32	0.34	0.50	0.39	0.39
22:00	0.98	0.98	0.98	0.38	0.32	0.33	0.48	0.38	0.39
23:00	0.99	0.99	0.99	0.37	0.32	0.32	0.45	0.38	0.38

MONITORING RECOMMENDATIONS AND REFERENCES

Metering individual equipment and office-level aggregated plug loads requires the installation of metering equipment and analysis of the data. This guide serves as a set of recommendations for a base set of data analysis but does not address the issues around the installation and gathering of meter data.

This section includes a few resources for meters, data acquisition and software tools for data analysis.

Metering and EMIS Equipment and Advice

PECI Guide on Energy Tracking

<http://www.cacx.org/PIER/documents/bpt-handbook.pdf>

NBI Guide on Advanced Metering and Energy Information Systems

<http://newbuildings.org/sites/default/files/metering-EPA%2083378201.pdf>

Metering Best Practices Guide – Federal Energy Management Program

<http://www1.eere.energy.gov/femp/pdfs/mbpg.pdf>

Meter and Data Acquisition Equipment Vendors

Data Acquisition Vendors

Obvius – www.obvius.com

Onset – www.onsetcomp.com

Metering Vendors

Veris – www.veris.com

Dent Instruments - www.dentinstruments.com

Wattnode - www.ccontrols.com

Power Meter Store – www.powermeterstore.com

Watt's Up Individual Outlet Metering – www.powerwerx.com

Web-Based Software Vendors

A few software vendors that work with office aggregate data.

Lucid – www.lucidenergy.com

Pulse – www.pulseenergy.com

Deck Monitoring – www.deckmonitoring.com